

**SHOP
DRAWING
REVIEW**

X

NOT REVIEWED
REVIEWED
REVIEWED AS NOTED
REVISE AND RESUBMIT

This review by Hilditch Architect Inc. is for the sole purpose of ascertaining conformance with the general design concept features only, and does not in any way constitute review of the design of engineering elements which form part of the Contract Documents prepared by others. This review shall not mean that Hilditch Architect Inc. approves the design detail inherent in the shop drawings, responsibility for which shall remain with the Contractor submitting same, and such review shall not relieve the Contractor of his responsibility for errors or omissions in the shop drawings or of his responsibility for meeting all requirements of the Contract Documents. The Contractor is responsible for dimensions to be confirmed and correlated at the job site, for information that pertains solely to fabrication processes or to techniques of construction and installation and for co-ordination of the work of all trades.

Hilditch Architect Inc.

By: Sasha Stairs

Project No: 1809

Date Rec'd:

Date Rev'd: 2025.02.25

GC/CM: 2025.02.24

Consultant: 2025.02.25

Submittal No. 12-R2


Grease Trap Shop Drawing

Project Name:
Neshama Hospice

Owner:
Neshama

Prime Consultant:
Hilditch Architect Inc

General Contractor: Renokrew

SHOP DRAWING <hr/> SUBMITTAL REVIEW	JOB NAME Neshama Hospice JOB # 24-130 DATE Feb 24, 2025
REVIEWED <input type="checkbox"/> REJECTED <input type="checkbox"/> REVIEW & RESUBMIT <input type="checkbox"/> REVIEW AS NOTED <input type="checkbox"/>	<p>This review is for general conformance of plans and specifications only. Approvals are subject to subcontractors performance within the confines of the contract documents. Review of dimensions will not serve to relieve the subcontractor of contractual responsibility for any deviation from the contract requirements.</p> <p>SPECIFICATION 23 08 10 ✓ SHOP DRAWING <input type="checkbox"/> PRODUCT DATA <input type="checkbox"/> DOCUMENTATION <input type="checkbox"/> LETTER</p> <p> RENOKREW TORONTO OTTAWA</p> <p>CHECKED BY: <input type="text"/> REVIEWED BY: <input type="text"/> TOTAL PAGES: 4</p>



54 Audia Court, Unit 2
Concord, ON L4K 3N5
(905)-738-1400

Submittal 24-256-009

PROJECT NAME	PROJECT ADDRESS	DATE SUBMITTED
NESHAMA HOSPICE	24-256 3 Cadillac Avenue North York, ON M3H 1R9	Jan 7, 2025

TO	FROM
Taranjeet Singh	PAUL LEDDY
COMPANY	COMPANY
1568796 ONTARIO INC. C/A RENOKREW	Consult Mechanical Inc.
EMAIL	EMAIL
taranjeet@renokrew.com	paul.l@consultmechanical.com
ADDRESS	ADDRESS
43 LEPAGE COURT TORONTO, ON M3J 1Z9	54 Audia Court, Unit 2 Concord, ON L4K 3N5

Title

~~Hot Water Tanks and~~ Grease Trap Revision 1

Description

~~Tag HWT-1/HWT-2 Manufacturer AO Smith~~
Tag GT-1 Manufacturer Goslyn

Package Items

SustainGlobe Ltd.

THIS DRAWING REVIEWED SOLELY FOR GENERAL CONFORMITY WITH DESIGN CONCEPTS. QUANTITIES, DETAILS, DIMENSIONS AND DESIGNS INHERENT IN THE SHOP DRAWINGS ARE THE CONTRACTOR'S RESPONSIBILITY TO VERIFY DATA WITH FIELD DIMENSIONS. CONTRACTOR IS SOLELY RESPONSIBLE FOR DESIGN OF MANUFACTURED ITEMS, FABRICATION PROCESSES AND TECHNIQUES OF CONSTRUCTION AND INSTALLATION OF EQUIPMENT.

DATE RECEIVED:

February 24, 2025

☒ MECHANICAL

☐ ELECTRICAL

☐ OTHERS

THIS DRAWING IS:

☒ REVIEWED

☐ REVIEWED AS NOTED

☐ REVIEWED AND
TO BE RESUBMIT

BY: TL

DATE: February 25, 2025

PROJ. NO.: 18031



goslyn™ MODEL GOS80LP

Low Profile 25 GPM

Grease Removal Device



Model: ☐ GOS80LP
Capacity: 25 Gallons / Minute

GOS80LP (Low Profile) – Standard Features:

- ☐ Heavy duty 2.5 mm, 304 Stainless Steel exterior construction
- ☐ Neoprene seals on base of unit
- ☐ Integral Vented Flow Control included (25 gal. / minute)
- ☐ The Goslyn™ meets (and exceeds) the industry codes and standards including UL, IPC, UPC, IRC, NPC, ASME A112.14.3, ASME A1123.14.4, PDI G101, and CSA B481.1
- ☐ Immersion heater (UL listed) to keep effluent warm during idle periods
- ☐ Self-closing drain valve included
- ☐ Strainer basket to prevent solid debris from entering the drain pipes
- ☐ Easy access hinged lid compartments
- ☐ Two oil collection cassettes included
- ☐ No moving parts
- ☐ Five Year Limited Warranty



Short Form Specification

- ☐ Shall be a Goslyn Model: GOS80LP grease removal device / immiscible liquid separator which continuously operates under hydro static pressure with no moving parts. Is made of 2.5 mm, 304 stainless steel and comes standard with an immersion heater and two (2) oil recovery cassettes. It has a capacity of 25 gallons per minute and meets the industry codes and standards including UL, IPC, UPC, IRC, NPC, ASME A112.14.3, ASME A1123.14.4, PDI G101, and CSA B481.1

"The easiest & most effective GRD to operate & maintain!"



Goslyn Canada
65 Underwriters Rd.
Scarborough, ON M1R 3B4


Phone: 905-841-0990
Fax: 905-248-5222
www.goslyn.ca






goslyn™ MODEL GOS80LP 25 GPM Grease Removal Device



Model:	GOS80LP
Shipping Dimensions	44" X 28.5" X 17 " 111.7 cm X 72.4 cm X 43.2 cm
Shipping Weight	148 lbs. / 67.1 Kg
Required Clearances	<ul style="list-style-type: none"> • Headroom needed above strainer basket: 12" • 2" inlet • 2" outlet • Access to front Oil Cassette • Access to hinged lid for Oil Valve
Codes/ Standards:	UL, IPC, UPC, IRC, NPC, ASME A112.14.3, ASME A112.14.4, PDI G101, and CSA B481.1
Electrical Requirements:	110 Volt, 1000 watts, 9 Amps within 5' of unit

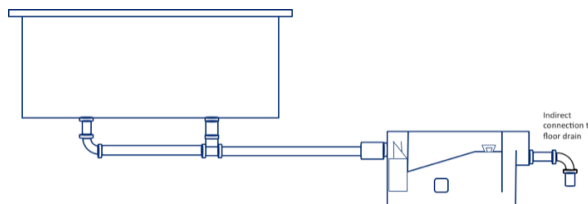

The Goslyn Outlet may **discharge either indirectly** (e.g., into a floor sink, as shown in the above schematic) **or directly** to a drainpipe.

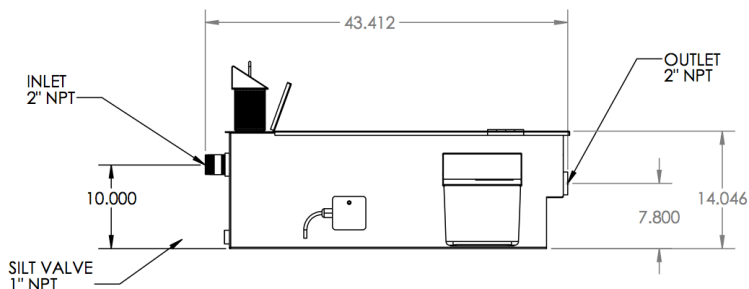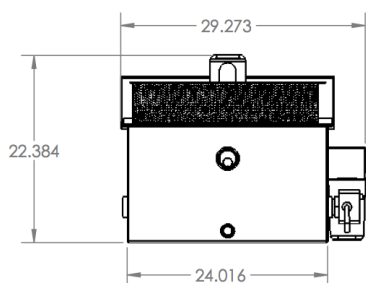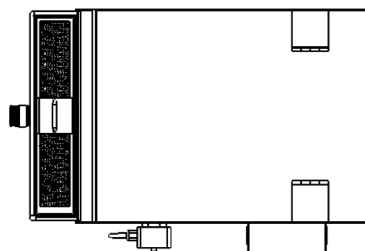

"The easiest & most effective GRD to operate & maintain!"



Goslyn Canada
65 Underwriters Rd.
Scarborough, ON M1R 3B4

Phone: 905-841-0990
Fax: 905-248-5222
www.goslyn.ca