

- ### INTERIOR WALL REQUIREMENTS
- UNDERSIDE OF ROOF STEEL DECK: $\pm 18'-8"$ A.C.F.
 - UNDERSIDE OF STEEL STRUCTURE: $\pm 18'-2"$ A.C.F.
 - EXISTING GROUND FLOOR CONSTRUCTION: APPEARS TO BE CONCRETE SLAB ON GRADE. SITE VERIFY
 - G.C. TO VERIFY LENGTH OF ALL WALLS WITH FUTURE CUT SHEETS ISSUED BY FUTURE MANUFACTURERS PRIOR TO PROCEEDING WITH CONSTRUCTION (TYPICAL)
 - PROVIDE STEEL STUD FRAMING SHOP DRAWINGS, DRAWINGS TO INCLUDE INTERIOR WALL STUDS, DRYWALL CEILING, SEISMIC BRACING, BULKHEAD DETAILS, SECURITY GRILLE BULKHEAD, ETC. DRAWINGS TO BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER LICENSED IN THE PROVINCE OF ONTARIO
 - ALL PLYWOOD USED IN THE NEW CONSTRUCTION FOR FASTENING OF FIXTURES, ACCESSORIES, ETC. IS TO BE FIRE-RATED PLYWOOD
 - TOP OF WALL TO BE BRACED TO THE ROOF ABOVE/ STRUCTURE FOR LATERAL STABILITY
 - PROVIDE DEFLECTION TRACKS AT TOP OF ALL WALLS EXTENDING TO U/S OF ROOF DECK, STRUCTURE, BEAMS, ETC.
 - TAPE AND SAND BOTH SIDES OF ALL GWB AND EXTEND GYPSON BOARD TO U/S OF DECK WHERE VISIBLE
 - USE 'GREEN BOARD' ON ALL PLUMBING WALLS IN UNIVERSAL WASHROOM, REGULAR WASHROOMS, AND JANITOR CLOSET
 - AT ALL LOCATIONS WHERE FULL HEIGHT WALLS ARE MORE THAN 16'-0" HIGH, USE LARGER GAUGE OF METAL STUDS
 - ALL EXPOSED METAL STUDS/ UNISURIT TO BE PAINTED BLACK
 - REGULAR WASHROOMS AND UNIVERSAL WASHROOM WALLS TO RECEIVE CERAMIC TILE (CT2), UP TO 4'-0"/ 5'-2" A.F.F. REFER TO DRAWING A1.1 FOR ELEVATIONS AND TILE HEIGHTS
 - WALLS OUTSIDE LOW WALL ON BEAUTY BOUTIQUE SIDE OF WALL, INSTALL CERAMIC TILE (CT4), UP TO 6'-0". EXPOSED EDGES TO BE FINISHED IN SCHLUTER EDGE STRIP IN BLACK ANODIZED (TYPICAL).
 - JANITOR CLOSET WALLS TO RECEIVE FIBERGLASS PLASTIC PANELS (FRP). FROM CERAMIC BASE TO UNDERSIDE OF CEILING
 - VESTIBULE WALL DADO: 54" HIGH X 3/4" THK WALL DADO C/W PLAM 8 BRUSHED ALUMINUM FINISH. EXPOSED EDGES TO 3/4" RECEIVE CLEAR ANODIZED TRIM
 - CART STORAGE WALL DADO: TO BE FINISHED WITH 3/4" THK DADO C/W PLAM 8 BRUSHED ALUMINUM FINISH. EXPOSED EDGES TO BE FINISHED IN SCHLUTER EDGE STRIP. FULL LENGTH AND HEIGHT OF LOW WALL AND 72" A.F.F. ON VESTIBULE FULL HEIGHT WALL
 - ALL GWB IS TO BE TAPE, SIGNED AND PAINTED. ALL WALLS CONSTRUCTED PART OF THE BASE BUILDING SCOPE OF WORK TO BE PAINTED PART OF THE INTERIOR FIT UP SCOPE OF WORK
 - REFER TO INTERIOR ELEVATIONS, ROOM AND PAINT SCHEDULES FOR PAINT LOCATIONS
 - REFER TO INTERIOR ELEVATIONS FOR ADDITIONAL PLYWOOD STRAPPING REQUIREMENTS
 - REFER TO CONSTRUCTION NOTES FOR ADDITIONAL INFORMATION/ REQUIREMENTS

- ### WALL SCHEDULE
- WALL TYPE 1 (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
1/2" GWB TAPED AND SANDED
- WALL TYPE 1A (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 1B (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED ON STORE SIDE ONLY
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION. REFER TO FLOOR PLAN FOR LOCATIONS
3-5/8" METAL STUDS @ 16" O.C.
ONTO EXISTING COLUMNS AND EXTERIOR WALLS
- WALL TYPE 1C (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED ON STORE SIDE ONLY
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION. REFER TO FLOOR PLAN FOR LOCATIONS
3-5/8" METAL STUDS @ 16" O.C.
ONTO EXISTING COLUMNS AND EXTERIOR WALLS
- WALL TYPE 1D (TO 72" A.F.F.)
1/2" GWB TAPED AND SANDED ON STORE SIDE ONLY
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION. REFER TO FLOOR PLAN FOR LOCATIONS
3-5/8" METAL STUDS @ 16" O.C.
ONTO EXISTING COLUMNS AND EXTERIOR WALLS
- WALL TYPE 1E (TO 120" A.F.F.)
1/2" GWB TAPED AND SANDED ON STORE SIDE ONLY
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION. REFER TO FLOOR PLAN FOR LOCATIONS
3-5/8" METAL STUDS @ 16" O.C.
ONTO EXISTING COLUMNS AND EXTERIOR WALLS
- WALL TYPE 1F (TO 72" A.F.F.)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 2 (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 2A (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 3 (TO 6" ABOVE CEILING)
1/2" GWB TAPED AND SANDED ON STORE SIDE ONLY
3-5/8" METAL STUDS @ 16" O.C.
ONTO EXISTING COLUMNS AND EXTERIOR WALLS
- WALL TYPE 4 (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 4A (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5 (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5A (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5B (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5C (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5D (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5E (TO 12" ABOVE T-BAR CEILING)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5F (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5G (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5H (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5I (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5J (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5K (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5L (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5M (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5N (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5O (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5P (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5Q (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5R (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5S (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5T (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5U (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5V (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5W (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5X (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5Y (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED
- WALL TYPE 5Z (TO U/S OF ROOF METAL DECK/ STRUCTURE)
1/2" GWB TAPED AND SANDED
3-5/8" METAL STUDS @ 16" O.C.
INFILL STUD VOIDS WITH SOUND ATTENUATION BATT INSULATION
1/2" GWB TAPED AND SANDED

THIS DRAWING IS AN INSTRUMENT OF SERVICE, IS PROVIDED BY AND IS THE PROPERTY OF DANIEL L. CUSIMANO, ARCHITECT.

THE CONTRACTOR MUST VERIFY AND ACCEPT RESPONSIBILITY FOR ALL DIMENSIONS AND CONDITIONS ON SITE AND MUST NOTIFY DANIEL L. CUSIMANO, ARCHITECT, OF ANY VARIATIONS FROM THE SUPPLIED INFORMATION.

THIS DRAWING IS NOT TO BE SCALED.

THE ARCHITECT IS NOT RESPONSIBLE FOR THE ACCURACY OF SURVEY, STRUCTURAL, MECHANICAL, ELECTRICAL, ETC. INFORMATION SHOWN ON THIS DRAWING. BEFORE THE APPROPRIATE CONSULTANTS' DRAWINGS ARE PREPARED, THE CONTRACTOR MUST VERIFY AND ACCEPT RESPONSIBILITY FOR ALL DIMENSIONS AND CONDITIONS ON SITE AND MUST NOTIFY DANIEL L. CUSIMANO, ARCHITECT, OF ANY VARIATIONS FROM THE SUPPLIED INFORMATION.

CONSTRUCTION MUST CONFORM TO ALL APPLICABLE CODES AND REQUIREMENTS OF AUTHORITIES HAVING JURISDICTION.


THE CONTRACTOR WORKING FROM DRAWINGS NOT SPECIFICALLY MARKED "FOR CONSTRUCTION" MUST ASSUME ALL RESPONSIBILITY AND BEAR COSTS FOR ANY CORRECTIONS OR DAMAGES RESULTING FROM HIS WORK.

DRAWINGS/SPECIFICATIONS "FOR CONSTRUCTION" ARE TO THE BEST OF OUR KNOWLEDGE AN ACCURATE REPRESENTATION OF DOCUMENTED REVISIONS. IN THE CASE OF ANY DISCREPANCY, OMISSION OR CONFLICT BETWEEN THE "FOR CONSTRUCTION" DOCUMENTS AND THE CONTRACT DOCUMENTS, THE CONTRACTOR IS TO PROMPTLY NOTIFY THE CLIENT, ARCHITECT AND ENGINEERS.

PRINT DATE:
2025-04-28

No.	DESCRIPTION	DATE
REVISIONS		

ISSUED FOR

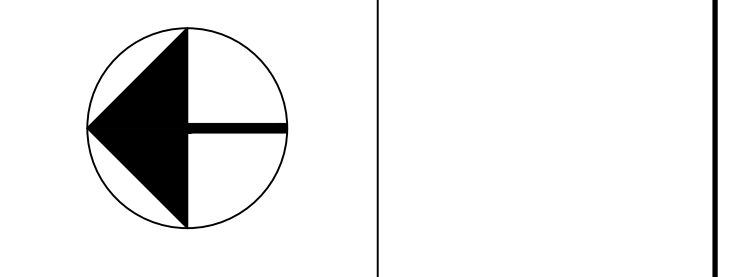

PROJ: INTERIOR ALTERATIONS TO EXISTING RETAIL BUILDING
SHOPPERS DRUG MART 9888
6500 MAJOR MACKENZIE DRIVE WEST, BUILDING A2
VAUGHAN, ONTARIO

DATE: OCTOBER 2024	REV: MP	CHK: SM/DLC
DRAWING TITLE:	PROPOSED PARTITION PLAN	