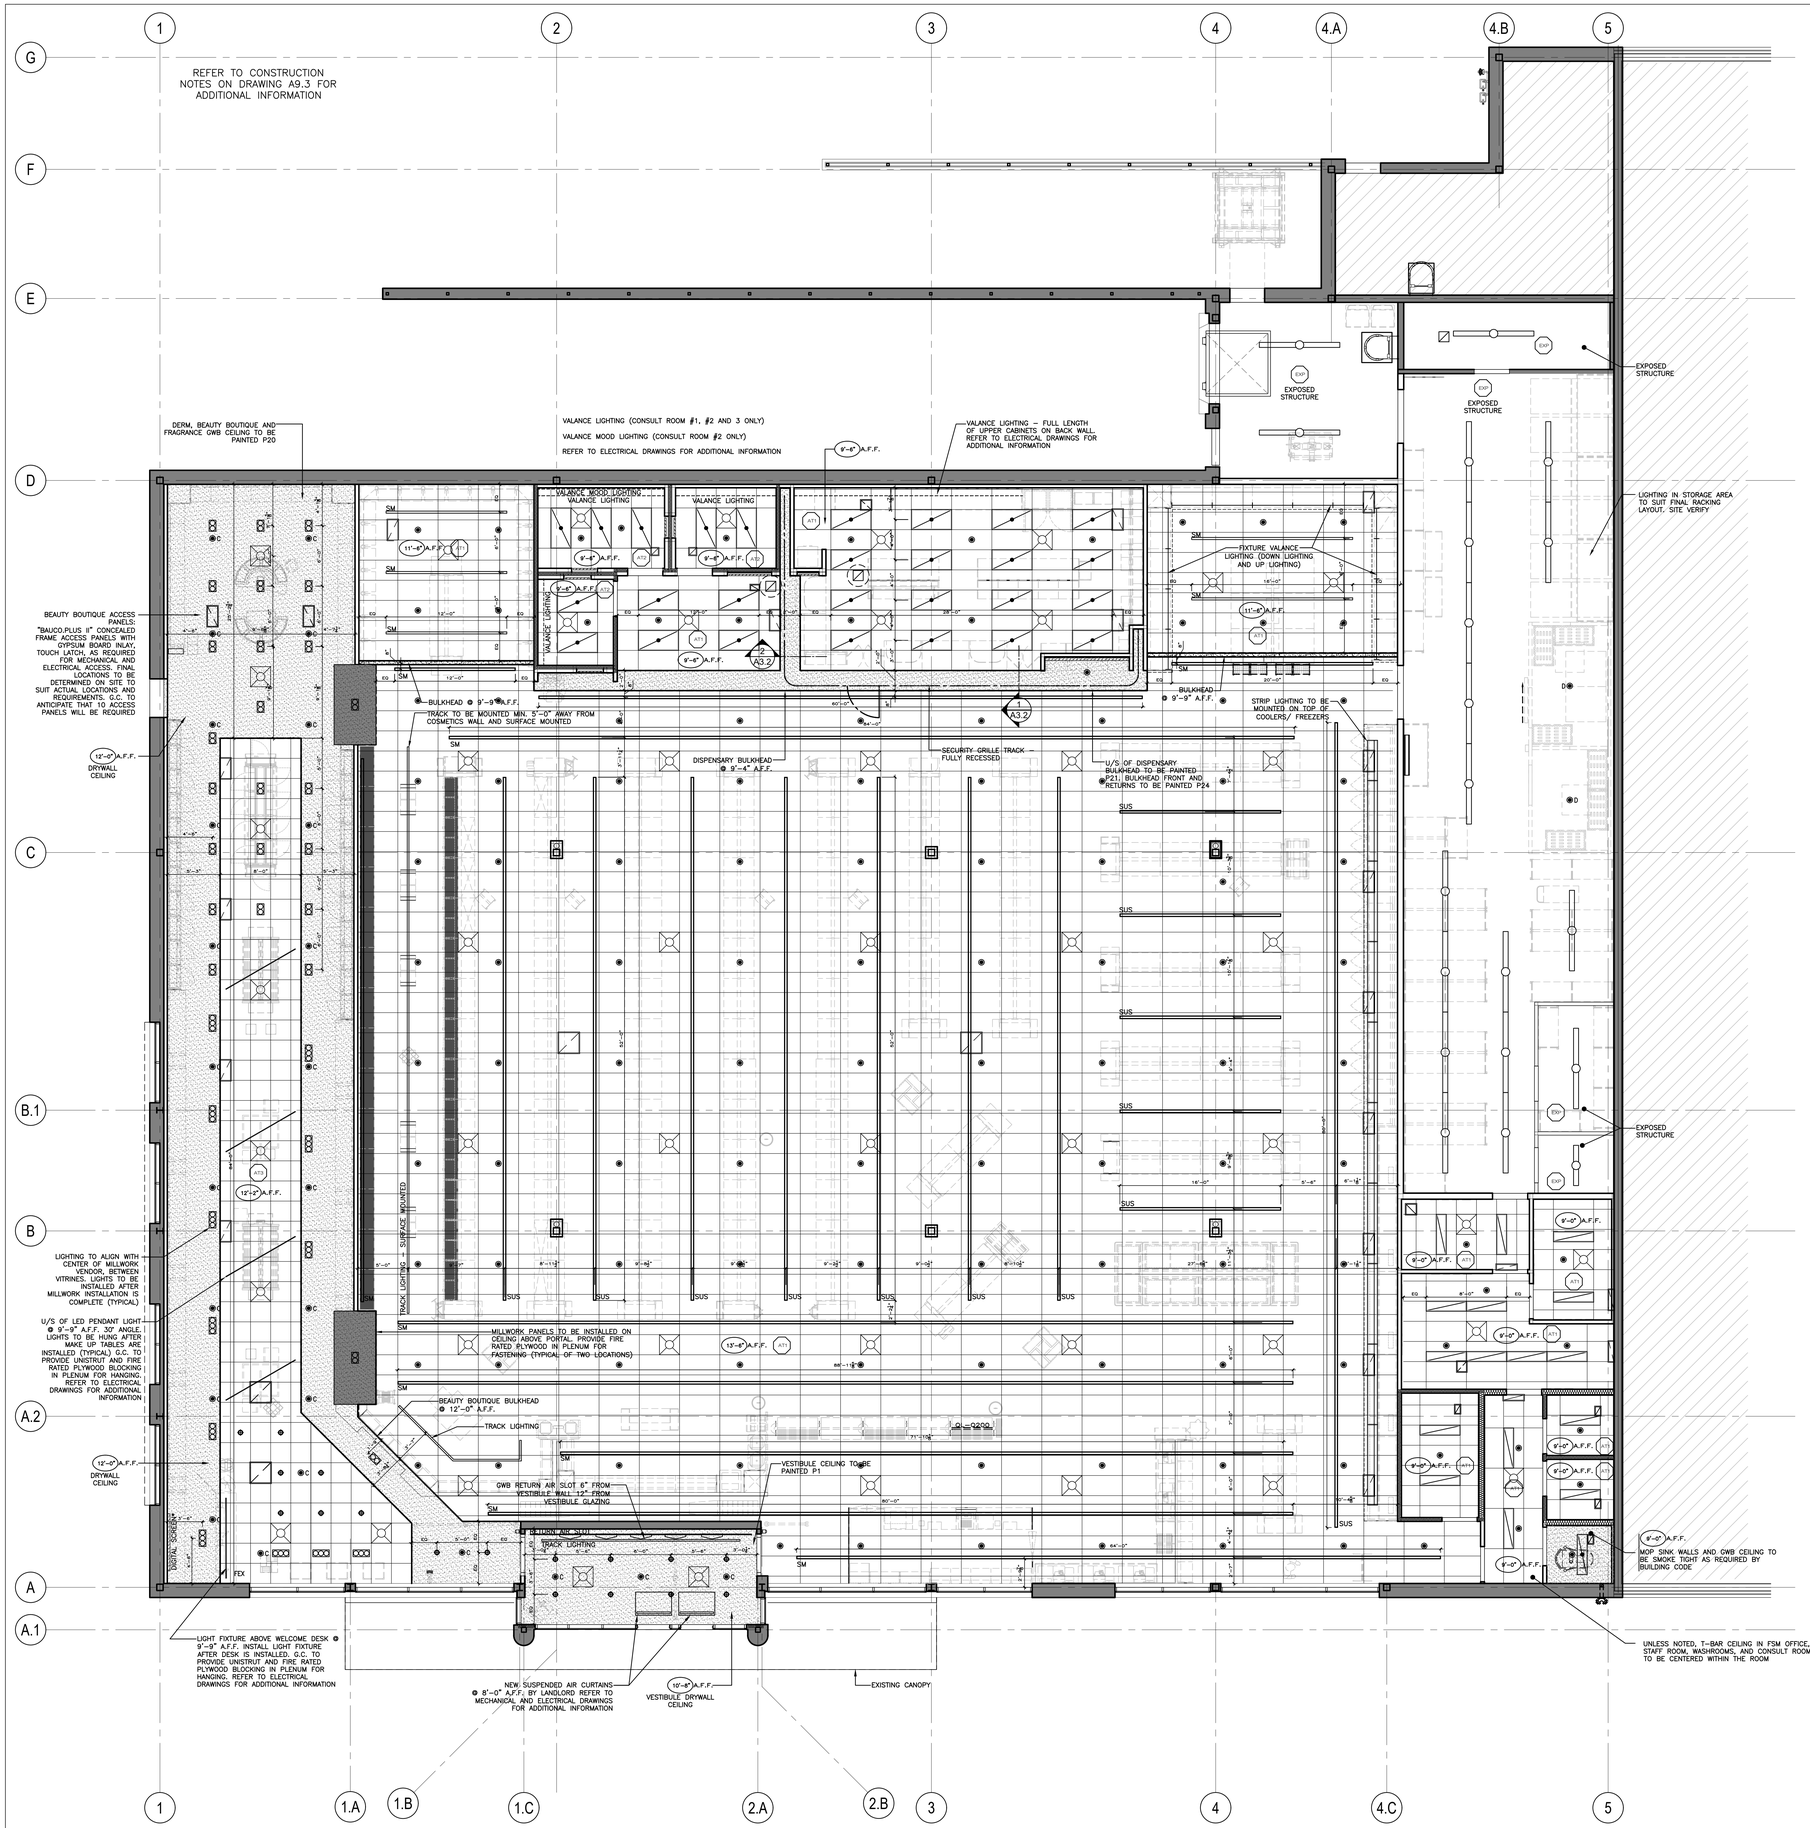

CEILING LEGEND

- SUPPLY AIR DIFFUSERS AND RETURN AIR GRILLES. REFER TO MECHANICAL DRAWINGS
- SPRINKLER HEADS. REFER MECHANICAL DRAWINGS
- SM — SURFACE MOUNTED SALES AREA LIGHT FIXTURES. REFER TO ELECTRICAL DRAWINGS
- SUS — SUSPENDED SALES AREA LIGHT FIXTURES. REFER TO ELECTRICAL DRAWINGS
- REFRIGERATION VALANCE LIGHTS. REFER TO ELECTRICAL DRAWINGS
- GREAT BUYS VALANCE LIGHTS. REFER TO ELECTRICAL DRAWINGS
- STOREFRONT LIGHTS. REFER TO ELECTRICAL DRAWINGS
- DISPENSARY LIGHTS. REFER TO ELECTRICAL DRAWINGS
- OFFICES, STAFF ROOM, WASHROOM, LIGHT. REFER TO ELECTRICAL DRAWINGS
- JANITOR ROOM LIGHT. REFER TO ELECTRICAL DRAWINGS
- STORAGE LIGHTS. REFER TO ELECTRICAL DRAWINGS
- POS DESK LIGHT. REFER TO ELECTRICAL DRAWINGS
- COSMETICS TRACK LIGHTS. REFER TO ELECTRICAL DRAWINGS
- BEAUTY BOUTIQUE QUAD LIGHTS. REFER TO ELECTRICAL DRAWINGS
- PENDANT LIGHT ABOVE MAKE UP TABLES. REFER TO ELECTRICAL DRAWINGS

- GYPSUM BOARD CEILING OR BULKHEAD, PAINT FINISH
- AT1: 2'x4' ACOUSTIC TILE AND GRID CEILING
- AT2: 2'x4' ACOUSTIC TILE AND GRID CEILING
- AT3: 2'x4' ACOUSTIC TILE AND GRID CEILING.

0'-0" A.F.F. CEILING FINISH : CEILING ELEVATION MARKERS

CEILING CONSTRUCTION NOTES:

REFER TO THE CONSTRUCTION NOTES ON DRAWING A9.3 FOR ADDITIONAL INFORMATION/ INSTRUCTIONS.

1. G.C. TO MAKE GOOD ALL AFFECTED/ DAMAGED AREAS (TYPICAL).
2. ANY DAYTIME WORK AREAS MUST BE PHYSICALLY SEPARATED FROM THE PUBLIC.
3. REFER TO FIRE PROTECTION PLAN FOR LAYOUT AND TYPE OF SPRINKLERS.
4. REFER TO ELECTRICAL DRAWINGS FOR LAYOUT AND TYPE OF LIGHT FIXTURES, EMERGENCY EXIT SIGNS, EXIT LIGHTS, ETC.
5. REFER TO MECHANICAL DRAWINGS FOR LAYOUT AND TYPE OF SUPPLY AND RETURN AIR DIFFUSERS AND GRILLES.
6. G.C. TO PROVIDE STEEL STUD FRAMING SHOP DRAWINGS. DRAWINGS TO INCLUDE DRYWALL CEILING, SECURITY GRILLE BULKHEAD, SEISMIC BRACING, BULKHEAD DETAILS, ETC. DRAWINGS TO BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER LICENSED IN THE PROVINCE OF ONTARIO.
7. BEAUTY BOUTIQUE CEILING TO BE DRYWALL BULKHEADS, DRYWALL CEILINGS AND T-BAR CEILING WITH ACCESS PANELS. G.C. TO PROVIDE STAMPED SHOP DRAWINGS WITH CEILING CONSTRUCTION DETAILS.
8. FINAL LOCATIONS OF ACCESS PANELS TO BE SITE VERIFIED.
9. ALL VISIBLE METAL STUDS AND UNISTRUT TO BE PAINTED BLACK.
10. ALL WALL AND CEILING FINISHES SHALL POSSESS A FLAME SPREAD RATING NOT EXCEEDING 150 AND 25 RESPECTIVELY.
11. ENSURE THAT ACCESS IS MAINTAINED TO ALL MECHANICAL AND ELECTRICAL SERVICES AND EQUIPMENT. PROVIDE SUITABLE ACCESS PANELS AS REQUIRED TO PROPERLY MAINTAIN OR REPAIR SUCH SERVICES AND EQUIPMENT. G.C. TO CARRY 20 ACCESS PANELS IN BID.
12. ALL WORK AND MATERIALS SHALL CONFORM TO THE BUILDING CODES OF AUTHORITIES HAVING JURISDICTION.
13. ALL PENETRATIONS THROUGH WALLS, FLOOR, ETC. REQUIRED TO MAINTAIN A FIRE RESISTANT RATING MUST BE SMOKE TIGHT AND SEALED ACCORDINGLY.
14. DO NOT PAINT OVER OR OTHERWISE COVER UP FIRE EVACUATION SPEAKERS.
15. NEW CONSTRUCTION TO COMPLY WITH OBC 3.1.5. NON-COMBUSTIBLE CONSTRUCTION.
16. CEILING SUPPORT: UNDER NO CIRCUMSTANCES SHALL HANGERS BE ATTACHED TO ANY BASE BUILDING STRUCTURE, ROOF PANS OR LANDLORD'S EQUIPMENT. GENERAL CONTRACTOR SHALL USE ONLY STRUCTURAL CHANNELS (SUCH AS "UNISTRUT")
17. TENANT'S CONTRACTOR IS REQUIRED TO PROVIDE FILTER BOX TO BASE BUILDING HVAC SYSTEM DURING DEMOLITION AND CONSTRUCTION OF THE PREMISES.
18. SOUND SYSTEM: PREMISES UTILIZING SOUND SYSTEMS SUCH AS STEREOS, RADIOS, TELEVISIONS, LOUD SPEAKERS, OR OTHER AUDIO VISUAL OR MECHANICAL DEVICES SHALL HAVE ALL DEMISING WALLS INSULATED TO THE UNDERSIDE OF THE ROOF DECK OR SLAB.
19. SMOKE SEPARATION: ENSURE A VERTICAL SMOKE SEPARATION IS MAINTAINED AT THE STOREFRONT AND DEMISING WALLS ABOVE THE CEILING AND UP TO THE DECK.
20. GENERAL CONTRACTOR TO COORDINATE SUBCONTRACTORS TO INSTALL ALL SPRINKLER LINES, DUCTWORK, ETC. AS HIGH AS POSSIBLE TO ACHIEVE THE CEILING HEIGHTS NOTED ON THE ARCHITECTURAL DRAWINGS. G.C. IS TO VERIFY ON SITE THAT CEILING HEIGHTS CAN BE ACHIEVED PRIOR TO PROCEEDING WITH CONSTRUCTION.
21. REMOVE ALL ITEMS NOT REUSED AND RELOCATED AT END OF PROJECT.
22. UNDER NO CIRCUMSTANCES SHALL THE CONTRACTOR COMPLETE DRILLING OR CORING, OPENINGS OR DEPRESSIONS IN THE FLOORS, COLUMNS, WALLS, OR ROOF OF THE STRUCTURE, WITHOUT APPROVAL FROM THE LANDLORD. ALL PENETRATIONS ARE TO BE SLEEVED, CAULKED, AND WATERPROOFED AND FIREPROOFED. ALL FLOORS MUST BE X-RAYED/SCANNED AT THE TENANT'S EXPENSE AND APPROVED BY THE LANDLORD.
23. G.C. TO COORDINATE WITH SDM FOR THE INSTALL OF VENDOR EQUIPMENT (SECURITY SYSTEM, SPEAKERS, LIGHTING CONTROLS, THERMOSTATS, ETC.)
24. G.C. TO PROVIDE UNISTRUT AND FIRE RATED PLYWOOD BLOCKING IN PLENUM FOR HANGING OF LIGHTING. REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION
25. ALL GWB IS TO BE TAPED, SANDED, PRIMED AND PAINTED.

NOTE:
SALES AREA LIGHTING NOTED AS 'SUS' ARE TO BE CENTERED ON AISLE AND IS TO BE SUSPENDED 11'-6" A.F.F.
SALES AREA LIGHTING NOTED AS 'SM' ARE TO BE SURFACE MOUNTED ON CEILING
FINAL LOCATION OF SALES AREA LIGHTING TO BE VERIFIED ON SITE WITH LATEST FIXTURE LAYOUT AND LIGHTS ARE TO BE INSTALLED AFTER SALES AREA FIXTURES ARE INSTALLED. NO EXCEPTIONS

THIS DRAWING, AS AN INSTRUMENT OF SERVICE, IS PROVIDED BY AND IS THE PROPERTY OF DANIEL L. CUSIMANO, ARCHITECT.

THE CONTRACTOR MUST VERIFY AND ACCEPT RESPONSIBILITY FOR ALL DIMENSIONS AND CONDITIONS ON SITE AND MUST NOTIFY DANIEL L. CUSIMANO, ARCHITECT, OF ANY VARIATIONS FROM THE SUPPLIED INFORMATION.

THIS DRAWING IS NOT TO BE SCALED.

THE ARCHITECT IS NOT RESPONSIBLE FOR THE ACCURACY OF SURVEY, STRUCTURAL, MECHANICAL, ELECTRICAL, ETC., INFORMATION SHOWN ON THIS DRAWING. REFER TO THE APPROPRIATE CONSULTANT'S DRAWINGS BEFORE PROCEEDING WITH THE WORK.

CONSTRUCTION MUST CONFORM TO ALL APPLICABLE CODES AND REQUIREMENTS OF AUTHORITIES HAVING JURISDICTION.

THE CONTRACTOR WORKING FROM DRAWINGS NOT SPECIFICALLY MARKED 'FOR CONSTRUCTION' MUST ASSUME FULL RESPONSIBILITY AND BEAR COSTS FOR ANY CORRECTIONS OR DAMAGES RESULTING FROM HIS WORK.

DRAWINGS/SPECIFICATIONS "ISSUED FOR CONSTRUCTION" ARE TO THE BEST OF OUR KNOWLEDGE AN ACCURATE REPRESENTATION OF DOCUMENTED REVISIONS. IN THE CASE OF ANY DISCREPANCY, OMISSION OR CONFLICT BETWEEN THE "ISSUED FOR CONSTRUCTION" DOCUMENTS AND THE CONTRACT DOCUMENTS, THE CONTRACTOR IS TO PROMPTLY NOTIFY THE CLIENT, ARCHITECT AND ENGINEERS.

PRINT DATE:
2025-04-28

No.	DESCRIPTION	DATE
	REVISIONS	
5	ISSUED FOR CONSTRUCTION	2025-04-28
4	KEY PLAN AND INTERIOR ELEVATIONS	2025-04-21
3	ISSUED FOR ADDENDUM #2	2025-03-14
2	ISSUED FOR TENDER	2025-02-27
1	ISSUED FOR BUILDING PERMIT	2024-11-08
No.	DESCRIPTION	DATE
	ISSUED FOR	

CUSIMANO ARCHITECT
185 BRIDGELAND AVENUE, SUITE 107, TORONTO, ONTARIO M6A 1Y7
T (416)783-5100 F (416)783-5193

PROJECT:
INTERIOR ALTERATIONS TO EXISTING RETAIL BUILDING
SHOPPERS DRUG MART 9688
6520 MAJOR MACKENZIE DRIVE WEST, BUILDING A2
VAUGHAN, ONTARIO

DATE:	DWN. BY:	CK'D. BY:
OCTOBER 2024	MP	SM/DLC

DRAWING TITLE:
PROPOSED REFLECTED CEILING PLAN

SCALE:	DRAWING No.:
3/16" = 1'-0"	A3.1
PROJ. NO.: 2024-24	