



fcREQUEST FOR INFORMATION

Date: January 27, 2025

Trisect Project No: TC24-114

Project Name: York Region Admin., Package D Renovation

CONSULTANTS RFI NO: TC24-114-24-X

To: Stephanie Kamburis @ G. Bruce Stratton Architects cc: Victor Chau @ York Region cc: Natalie Freitas @ York Region From: Tom Butkovic, Ivan Lulic, Jay Cowie	REFERENCE: Washroom Revisions due to Space Limitations Spec. Section: Drawing No.(s): Various Attachments: Photos
--	--

Interior Design ☐ Architectural ☐ Structural ☐ Mechanical ☒ Electrical ☐

RESPONSE/INFORMATION REQUIRED BY: [Jan. 31, 2025](#)

On behalf of the mechanical subcontractor, please review and reply to the following RFI:





54 Audia Court, Unit 2
Concord, ON L4K 3N5
(905)-738-1400

Request For Information 24-277-010

Jan 27, 2025

Project Name

YORK REGION VARIOUS PROJECTS

Project Address

17250 Young Street Newmarket, ON

To

Name

Tom Butkovic

Company

TRISECT CONSTRUCTION

Email

tbutkovic@trisectconstruction.com

Address

4020A SLADEVIEW cRESCENT, UNIT 7 MISSISSAUGA,
ON L5L 6B1 JOB: 1300 INSLINGTON SUITE 103

From

Name

INZAMAN KHAN

Company

Consult Mechanical Inc.

Email

inzaman@consultmechanical.com

Address

54 Audia Court, Unit 2 Concord, ON L4K 3N5

Title

Washroom revision due to space limitations

SCHEDULE IMPACT

Probable

COST IMPACT

Probable

RETURN BY

Jan 31, 2025

Information Requested

Please refer to the below 3 options and advise:

1. Re-works of the piping services in the chase impeding the new design.
2. Reorientations of the layout by switching the WC and urinal placement
3. Possibility of a smaller WC carrier. See alternate option attached.

GPY response: Alternate WC carrier can be used as long as the alternate carrier is compatible with the specified water closet. Coordinate mounting height with the Architect.

Engineering Specification

Job Name _____

Contractor _____

Job Location _____

Approval _____

Engineer _____

Contractor's P.O. No. _____

Approval _____

Representative _____

ISCA-121-BF

Industry Standard Vertical Carrier for Floor Mounted Back Outlet Bowl Specification

Watts ISCA-121-BF *Industry Standard* vertical water closet carrier for floor mounted back outlet bowl, with epoxy coated cast iron fitting, 4"(102) no hub waste and 2"(51) no hub vent connections, epoxy coated cast iron foot supports and patented compression seal faceplate assembly, ABS nipple with integral test cap and neoprene bowl gasket, plated hardware and chrome cap nuts.

Call customer service if you need assistance with technical details.

Options		
Suffix	Description	
-CI	Cast Iron Nipple	<input type="checkbox"/>
-HS	Hub & Spigot Connections	<input type="checkbox"/>

NOTICE

Anchor legs to concrete floor with minimum 1/2"(13) anchor bolts (by others).



Dual slotted carrier feet require one 1/2"(13) anchor bolt per foot.

$x = 5 \frac{3}{4}"(146)$ Maximum with Standard Nipple

NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

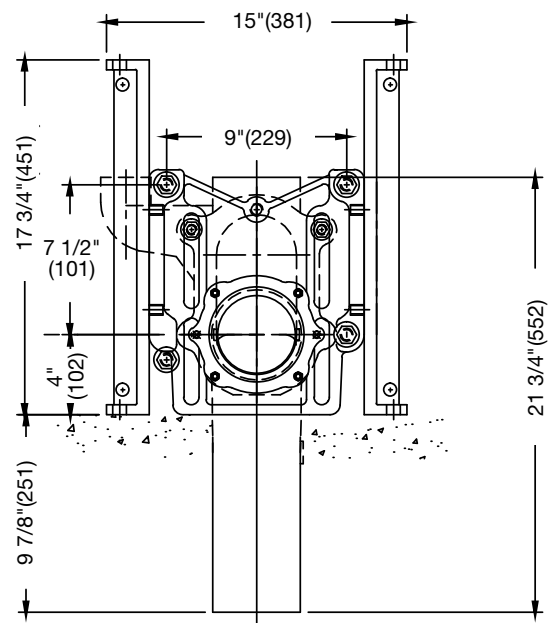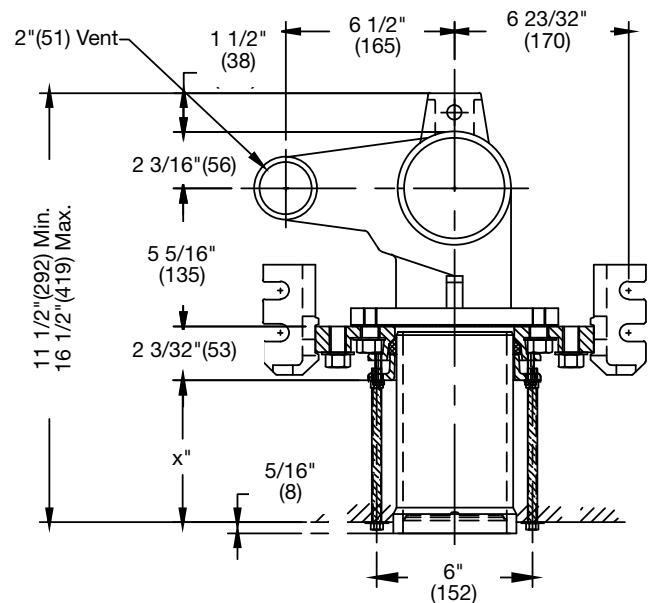

USA: T: (800) 338-2581 • Watts.com

Canada: T: (888) 208-8927 • Watts.ca

Latin America: T: (52) 55-4122-0138 • Watts.com

ES-WD-ISCA-121-BF 2348

© 2023 Watts

