Dependable Mechanical Systems Inc.



Mechanical & Electrical Contractors

50 Four Valley Drive, Concord, Ontario. L4K 4T9 Tel: (905) 660-9144 Fax (905) 660-9145 Website: http://www.dsmcorp.ca Email:info@dmscorp.ca


Request for Information


RFI# M-0138


To:	Rob Piti & Kyrollos	From:	Apinder Singh
Fax:		Pages:	1(Including Cover)
Phone:		Date:	2025-05-13 12:30:19
Re:	McMaster University -Confirmation to HTS for Runtal Release		
□ Urgent ⋈ For Review □ Please Reply □ Attachment			

We seek consultant confirmation on following issues raised by HTS to proceed with Runtal release to ${\sf Production}$.


1. Confirmation to move lines to proposed location for Tags below for radiator connections.

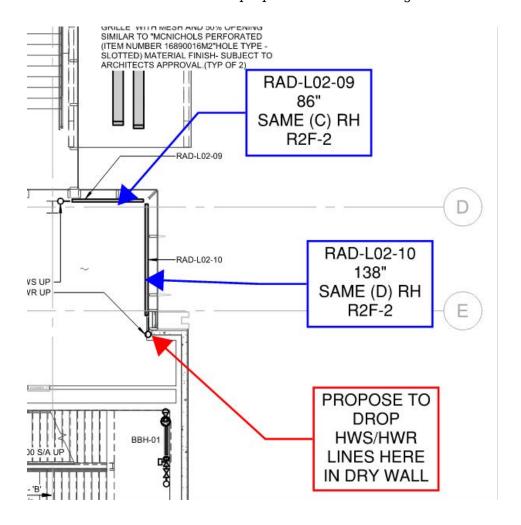

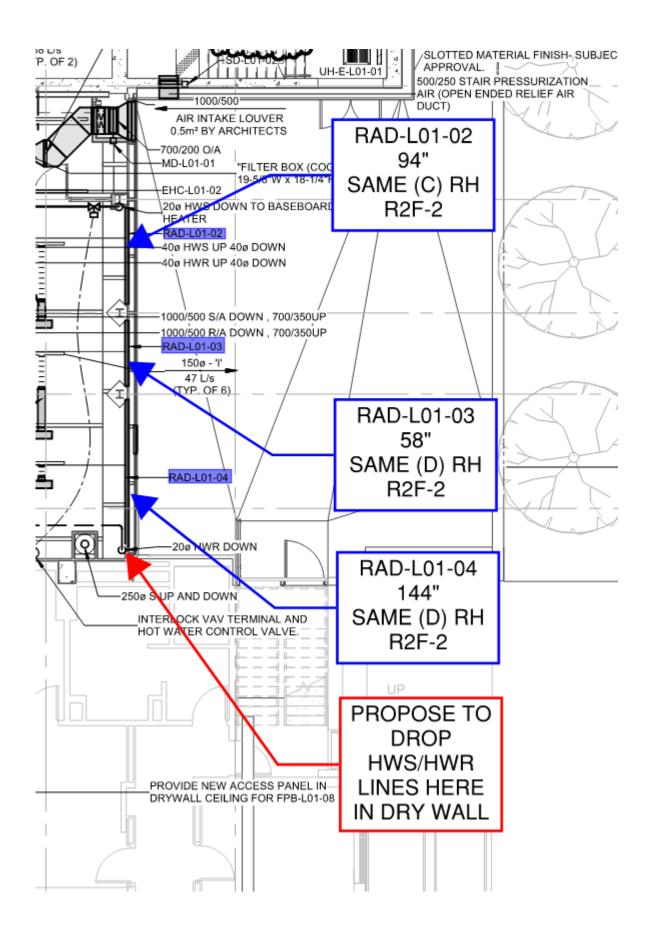

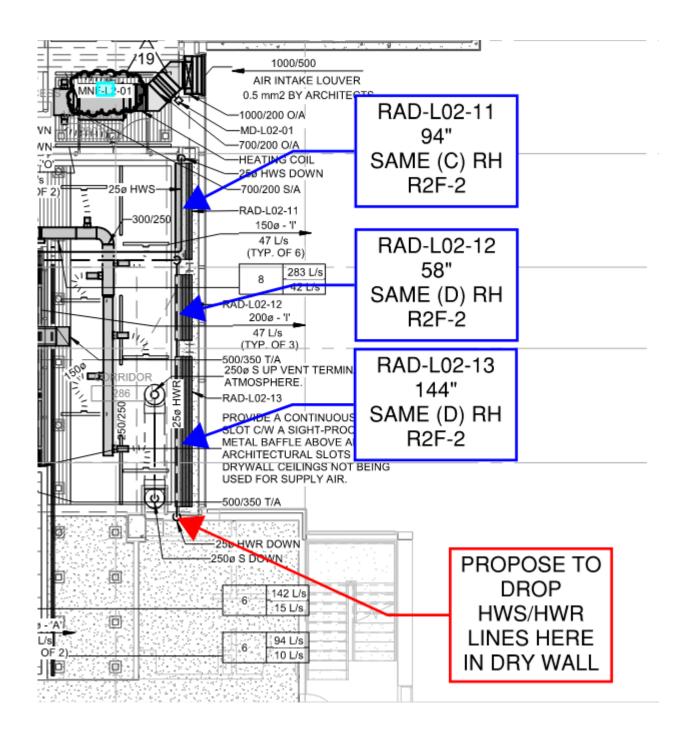

2. Need confirmation of handling for radiator below. (Right Hand/ Left Hand)

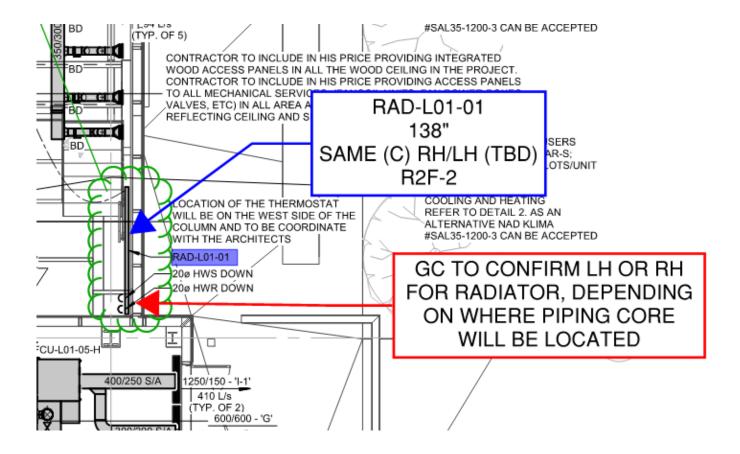

3. Confirmation to approve the lengths as per release schedule. All lengths are based on site measurements conducted on site with Buttcon. HTS has allowed 8" clearance from piping stub out to radiator connection ,6" from columns on both sides of column when radiators are piped in series, as advised by Buttcon .